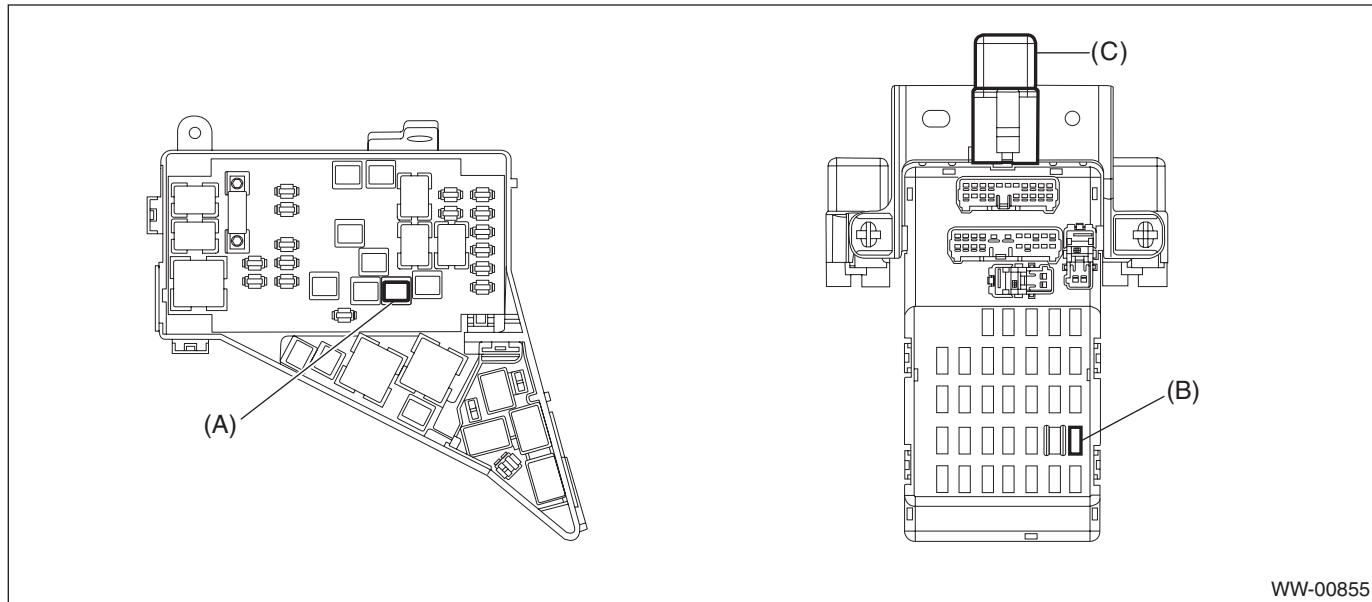


2. Relay and Fuse

A: LOCATION



WW-00855

Main fuse box	Fuse 50 A (wiper)	(A)
Relay & fuse box	Fuse 7.5 A (wiper)	(B)
Relay holder	Wiper relay	(C)

NOTE:

For other related fuses, refer to the wiring diagram. <Ref. to WI-15, Power Supply Circuit.>

Relay and Fuse

WIPER AND WASHER SYSTEMS



B: INSPECTION

1. CHECK FUSE





- 1) Remove the fuse and inspect visually.
- 2) If the fuse is blown out, replace the fuse.

2. CHECK RELAY

- 1) Check the resistance between relay terminals.

Terminal No.	Inspection conditions	Standard	Circuit
1 — 2	Always	1 MΩ or more	 
1 — 2	Apply battery voltage between terminals 4 and 3.	Less than 1 Ω	

SR-00180

Terminal No.	Inspection conditions	Standard	Circuit
1 — 2	Always	1 MΩ or more	 
1 — 4	Always	Less than 1 Ω	
1 — 2	Apply battery voltage between terminals 3 and 5.	Less than 1 Ω	 
1 — 4	Always	Less than 1 Ω	

SL-01085

- 2) Replace the relay if the inspection result is not within the standard.